


Actual Supply & Power Position of Date: 16.03.2025

Actual Power Availability			Energy (MU)	Actual Rostering on dated: 16-03-2025	
1	State Generation		9.93	AREA	HRS.
2	Central Share to Uttarakhand & V.P. Share		17.85	Rural of Haridwar & U.S. Nagar Distt.	Nil
Total from firm sources			27.78	Small Towns	Nil
3	Power from other sources	a) Power Purchase/Return Banking	11.71	Other Towns	Nil
		b) Net IEX/PXIL Drawl	- 4.04	Hills	Nil
		c) Grid Overdrawl (+) / Underdrawl (-)	- 1.01	Steel Furnaces	Nil
Total from other sources			6.66	Non Continuous Industries	Nil
4	Total Availability		34.44		
5	Rostering		0.00		
6	Actual Demand		34.44		

AVAILABILITY FROM CSGS VS ACTUAL DRAWL

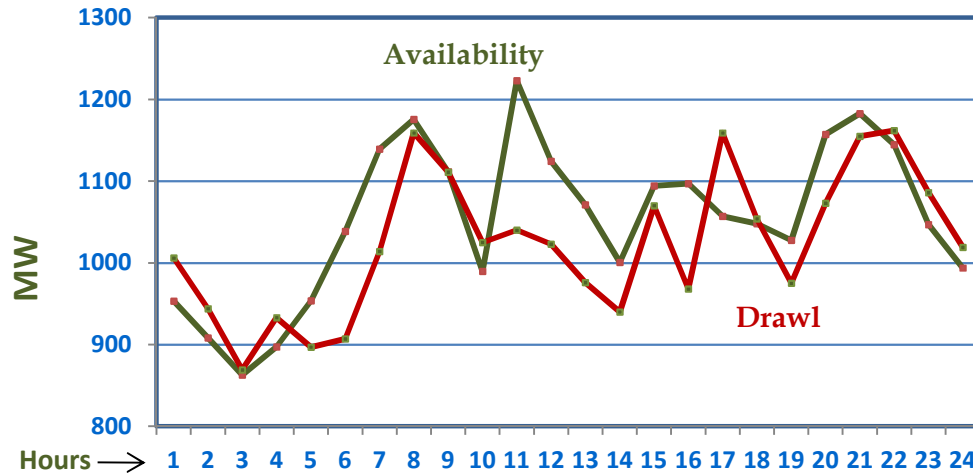

TRANSMISSION CONSTRAINTS / CONTINGENCY		
Substation	Hrs.	Reason
220 KV S/s Jhajhra	0:22	Due to Grid Supply fail.

Small Towns :	Landhora Town, Manglore Town, Laksar Town, Bahadrabad Town, Dhakrani, Selaqui, Sahaspur, Vikasnagar, Doiwala, Kotdwar, Jwalapur, Jaspur Town, Kichha Town, Khatima Town, Ramnagar Town, Gadarpur Town & Bazpur Town.
Other Towns :	Rudrapur, Kashipur, Haldwani, Sitarganj & Roorkee Town.